




SPEEDFIT™

www.pewelectrical.com
T: 0870 600 6503

Lift Shaft Structured Cabling-Block Diagram (With non-emergency luminaire)

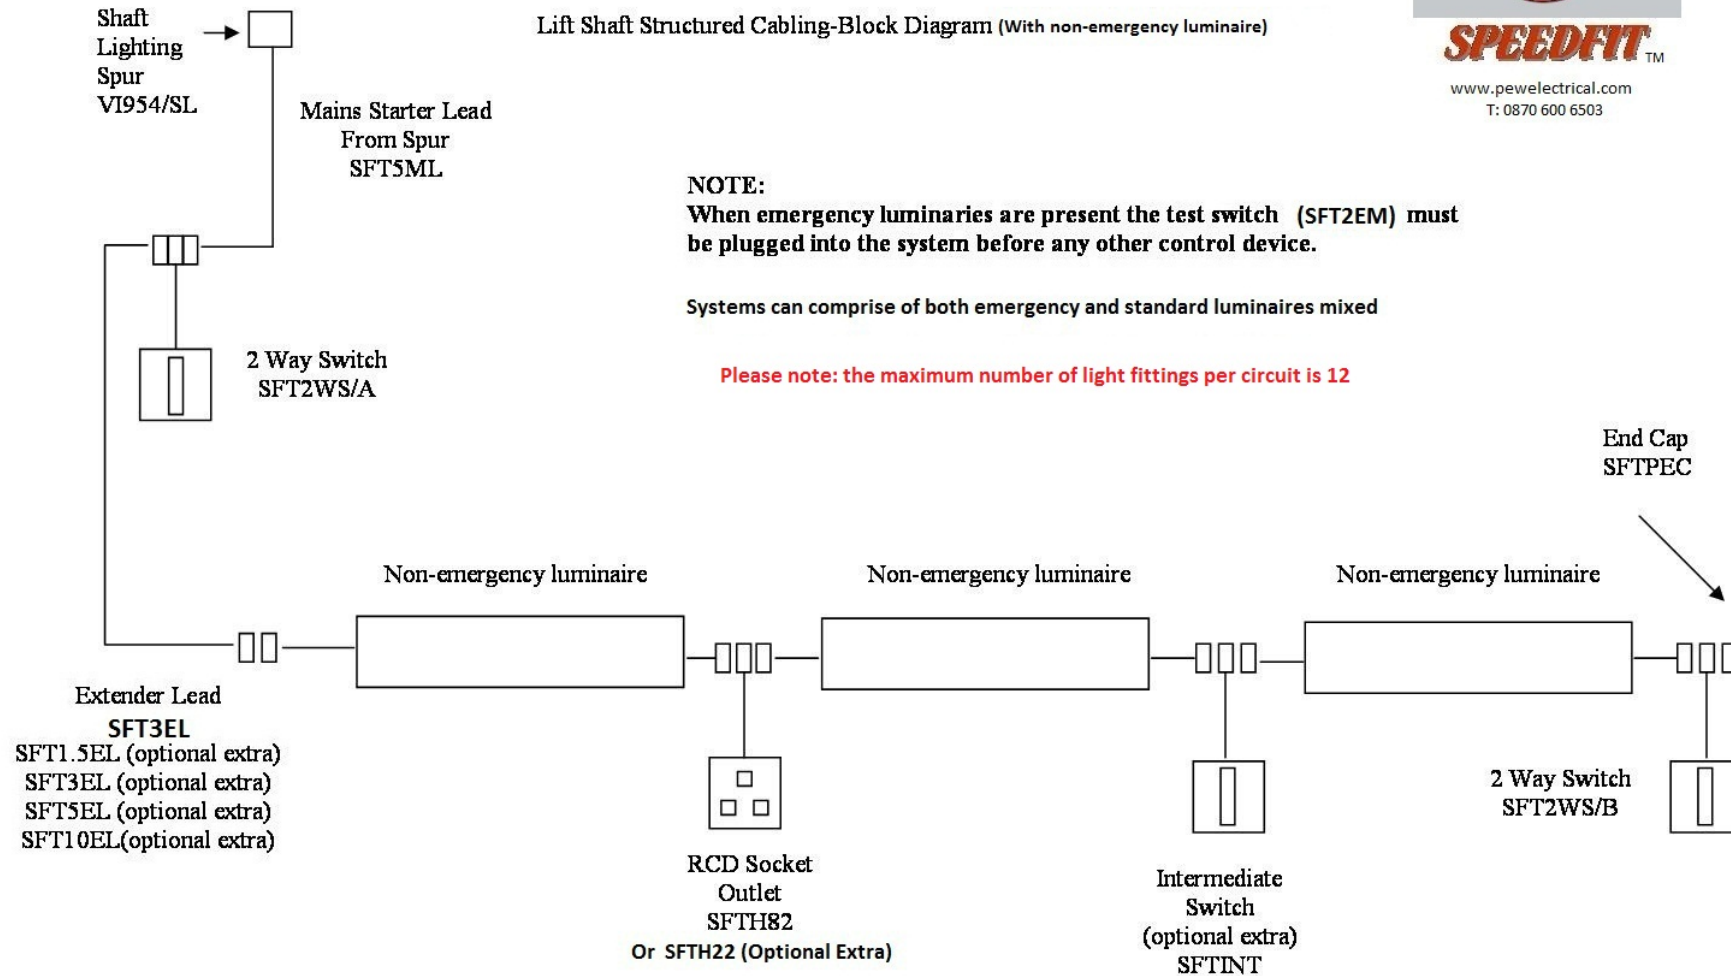

NOTE:

When emergency luminaires are present the test switch (SFT2EM) must be plugged into the system before any other control device.

Systems can comprise of both emergency and standard luminaires mixed

Please note: the maximum number of light fittings per circuit is 12